


**Project:**

Reinforcement of an existing Power Plant with Two additional Gas Turbine Generator with 132 kV grid interconnection and Plant Auxiliaries represented completely

**Client:**

A Multinational Consulting Engineering Company

**Single Line Diagram of the Plant**

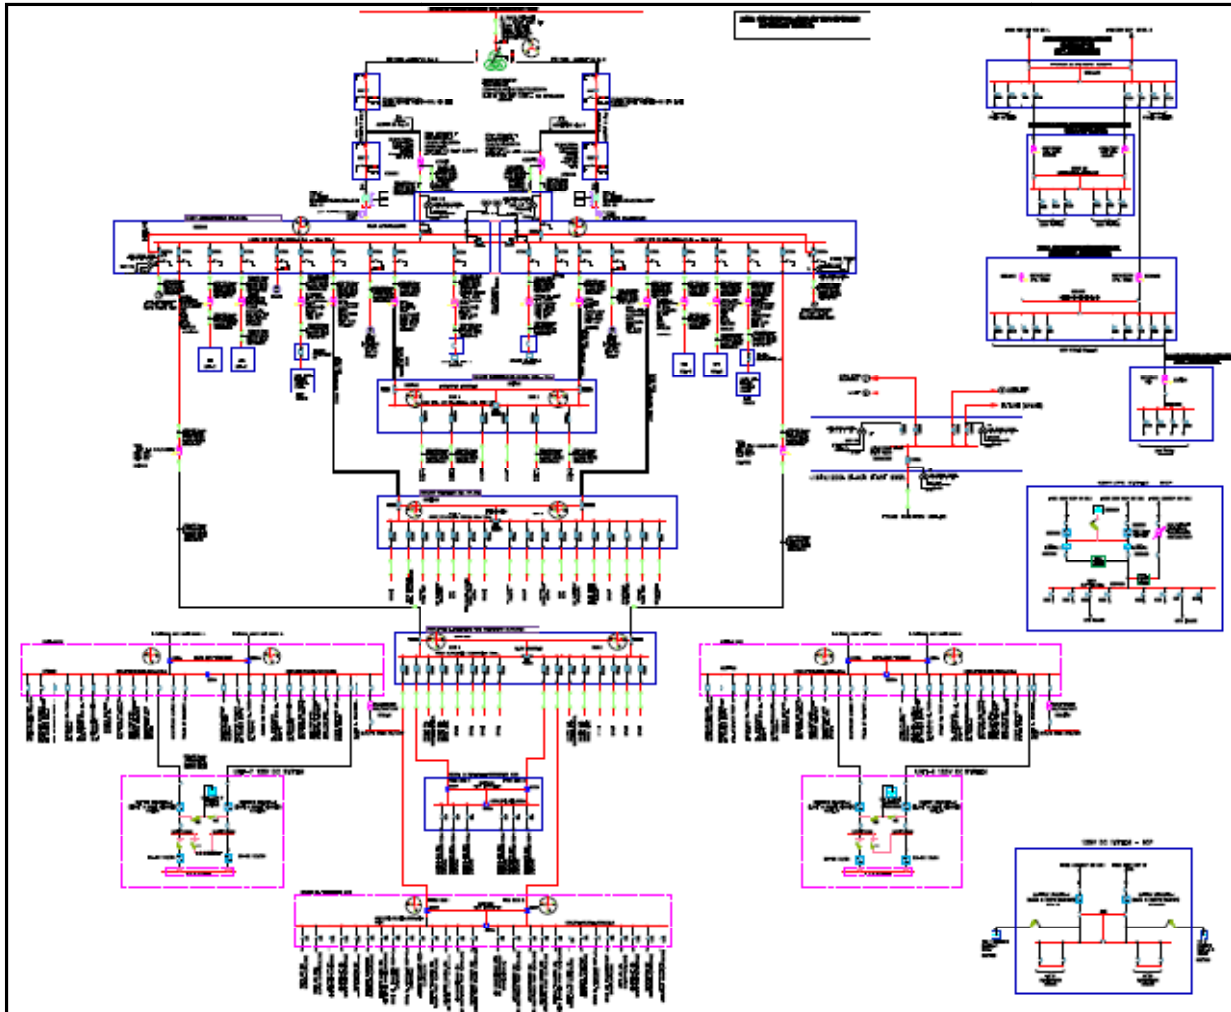

**Scope of the Studies**

- Load Flow Study
- Short Circuit Study
- Protection & Coordination

**Software Used**

PowerApps software was used for the studies.